


GRAYWATER SYSTEM NOTES:  
 1- THE INSTALLER OF THE GRAYWATER SYSTEM SHALL PROVIDE AN OPERATION AND MAINTENANCE MANUAL TO THE OWNER OF THE SYSTEM.  
 2- ALL GRAYWATER PIPING SHALL BE MARKED AS FOLLOWS: "DANGER - UNSAFE WATER".  
 3- THE CONTRACTOR SHALL INSTALL THE FOLLOWING LABEL ON THE SURGE TANK:  
 "GRAYWATER IRRIGATION SYSTEM, DANGER-UNSAFE WATER"



- LIQUID CAPACITY: 750 GALLONS
- TANK DESIGNED FOR H-20 TRAFFIC WHEEL LOAD WITH DRY SOIL CONDITIONS (WATER TABLE BELOW TANK)
- EARTH COVER OVER TANK NOT TO EXCEED 6 FT.
- SUITABLE NATIVE OR SUB-BASE SHALL BE PREPARED TO HANDLE ANTICIPATED LOADS. THE EXCAVATION SHALL BE BEDDED WITH SUITABLE GRANULAR MATERIAL AND SHALL BE COMPACTED TO 90% MAXIMUM DRY DENSITY, OR TO REQUIREMENTS OF THE PROJECT GEOTECHNICAL ENGINEER.

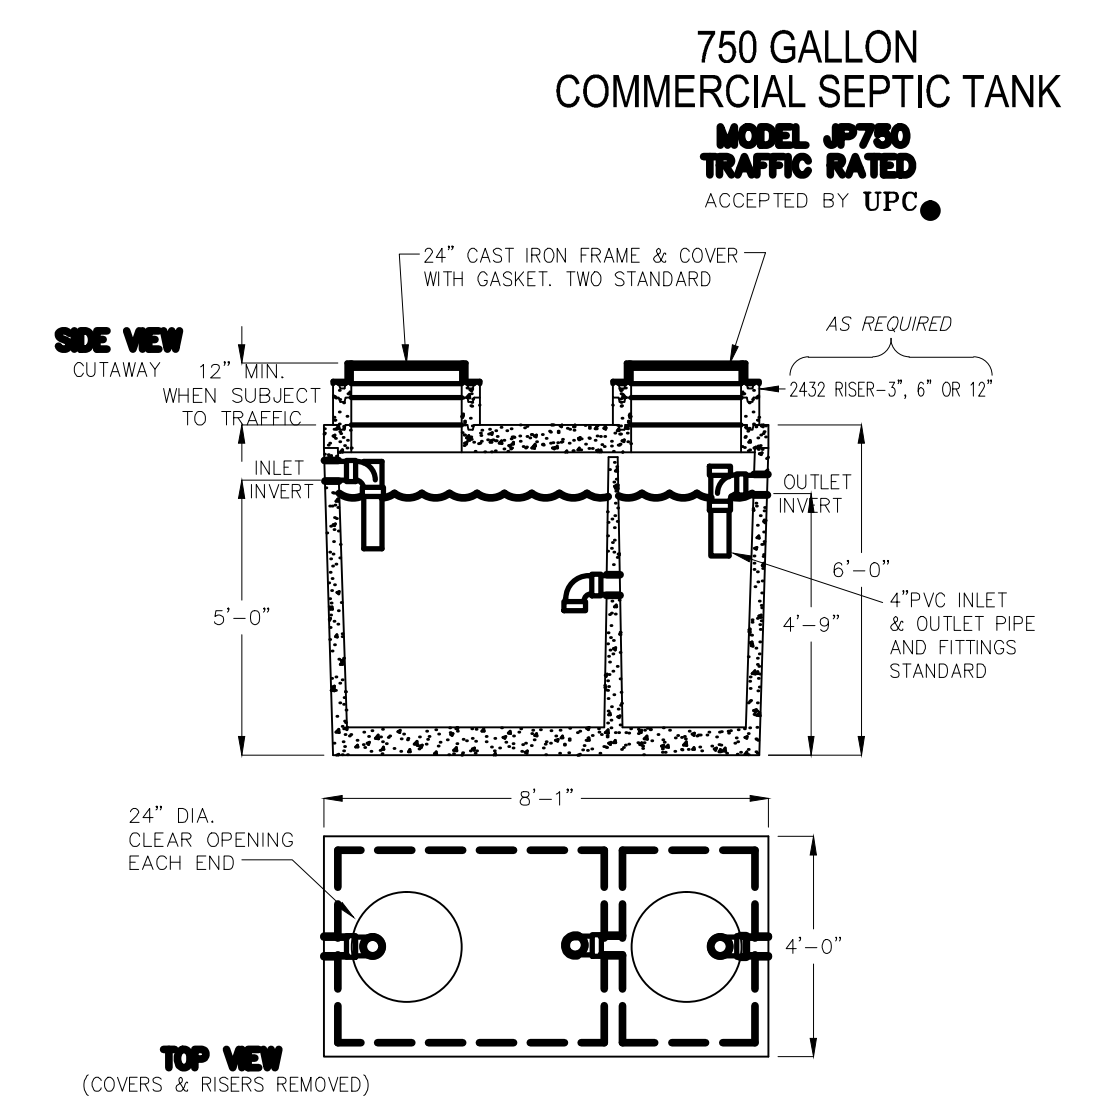

REWATER SYSTEMS, INC.  
 3362 JESSICA STREET  
 NEWBURY PARK, CA 91320

TEL: (805)262-2954

SUPPORT@REWATER.COM  
 WWW.REWATER.COM

# 1 ENLARGED GRAYWATER FILTRATION SYSTEM BY REWATER

# 2 SURGE TANK - NTS

1

2

3

4

5

DATE	APP'R	DESCRIPTION



FINAL DESIGN  
 SUBMITTAL

SUBMITTED BY	DATE	
FIRM MEMBER	DATE	
APPROVED	DATE	
ACTIVITY - SATISFACTORY TO	DATE	
APPROVED	DATE	
FOR COMMANDER NAFAC	DATE	
DES	DR	TJC
CHK	QC	###
DESIGNER		
REVIEWED BY		
QC		
AIC/EIC		
FIRE PROTECTION		
BRANCH MANAGER		
DESIGN DIRECTOR		

NAVAL FACILITIES ENGINEERING COMMAND  
 SAN DIEGO, CA  
 SOUTHWEST DIVISION  
 OCEANSIDE, CALIFORNIA  
 MCB CAMP PENDLETON  
 FY09 MCON PROJECT P-330  
 INDOOR PHYSICAL FITNESS CENTER  
 ENLARGED GRAYWATER FILTRATION SYSTEM

CODE ID. NO.	80091	SIZE	0
SCALE	NTS		
JOB ORDER NO.			
SPEC. NO.			
CONSTR. CONTR. NO.			
NAVFAC DRAWING NO.	###		
SHEET	126	OF	163
<b>P403-GW</b>			

DRAWING REVISION: 15 MARCH 2004

REVDATE: 01/22/10 FILE NAME: N:\1002\1002-003\1002-ENLARGED SYSTEM.dwg LAYOUT NAME: Layout1 PLOTTED: Friday, January 22, 2010 - 3:54pm

1

2

3

4

5